

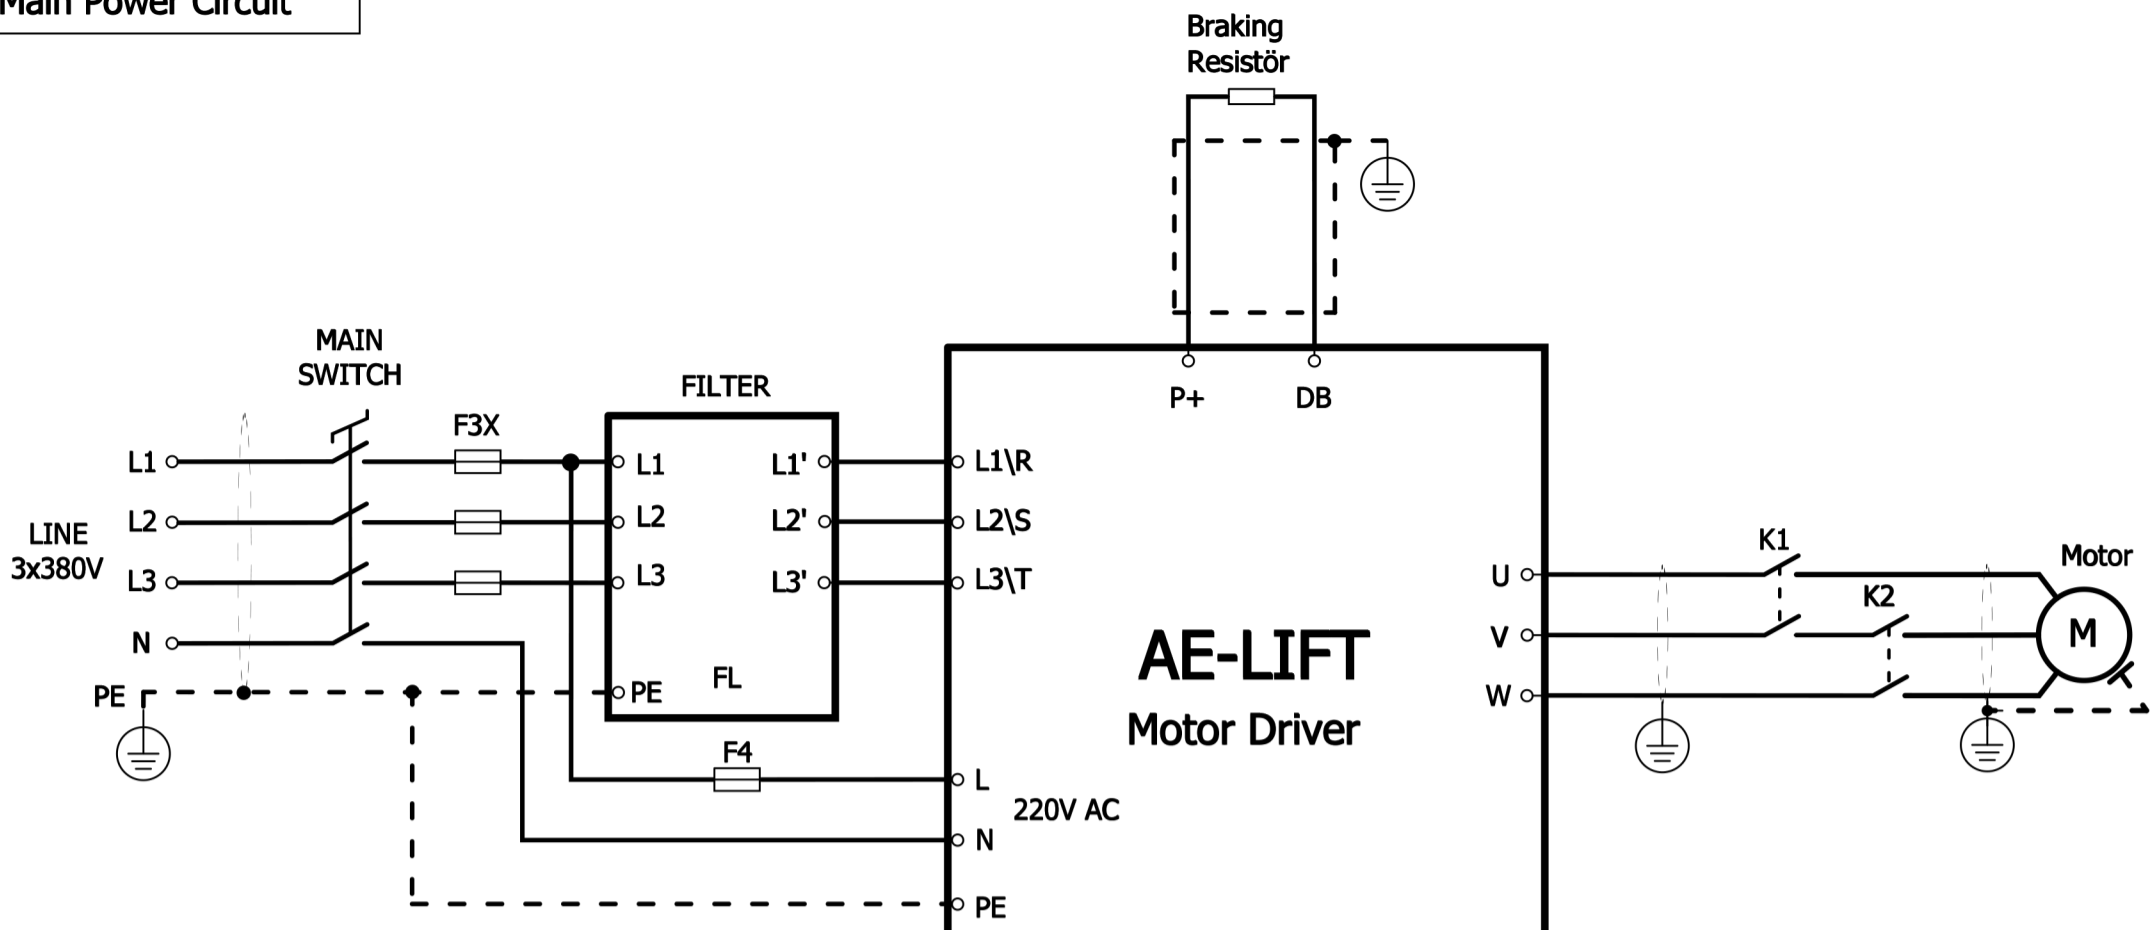


Main Power Circuit



Control Circuit

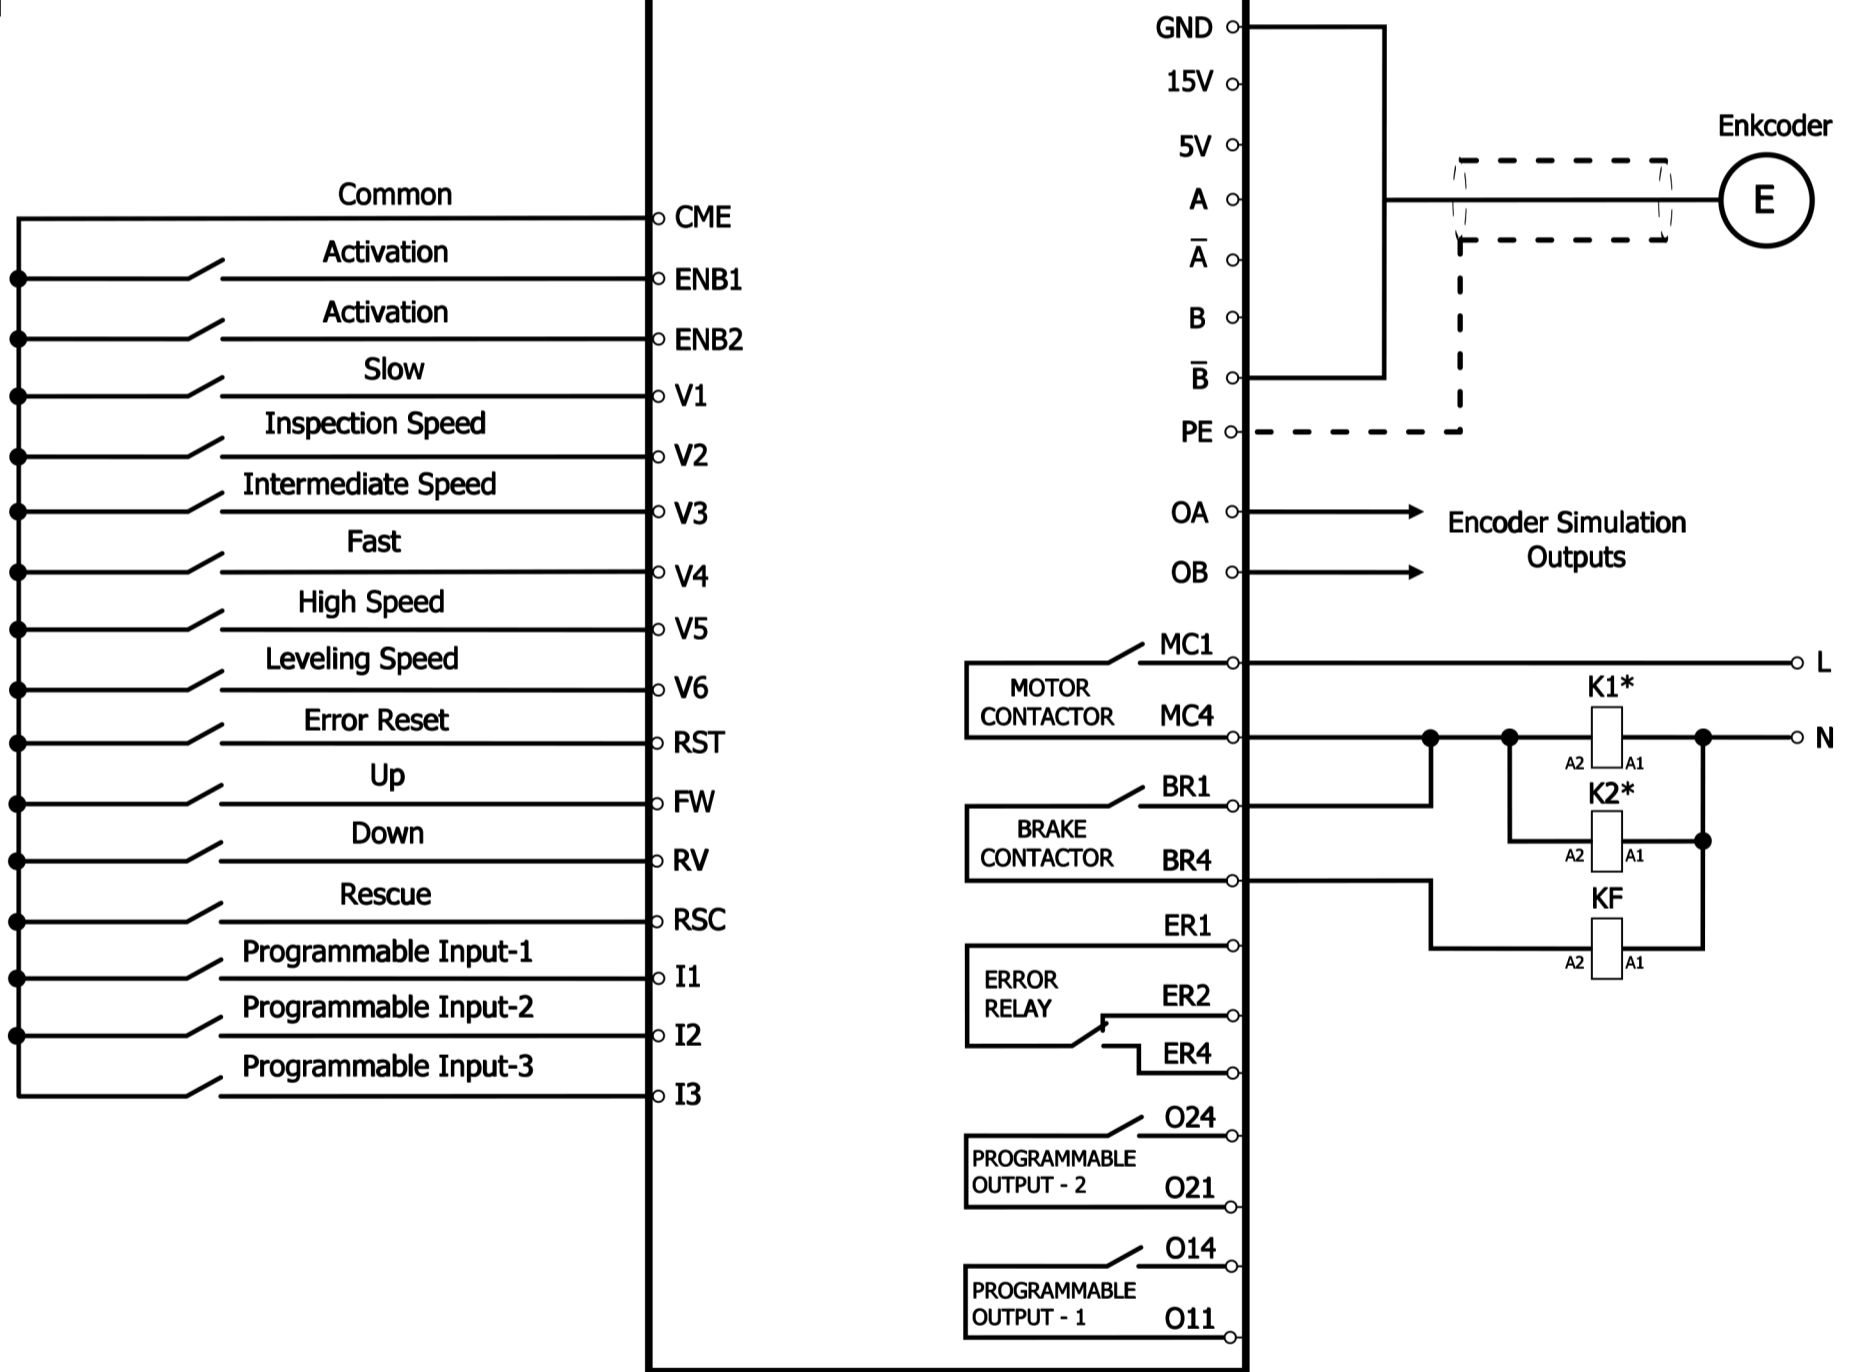

When motor contactors (K1*-K2*) are switched by AE-LIFT motor driver, any of programmable inputs I1, I2, I3 should be defined as contactor feature (MCF). And this connection should be implemented.

AE-LIFT ELECTRICAL CONNECTIONS

for models AEL04 (4 kW) and AEL05 (5,5 kW)