

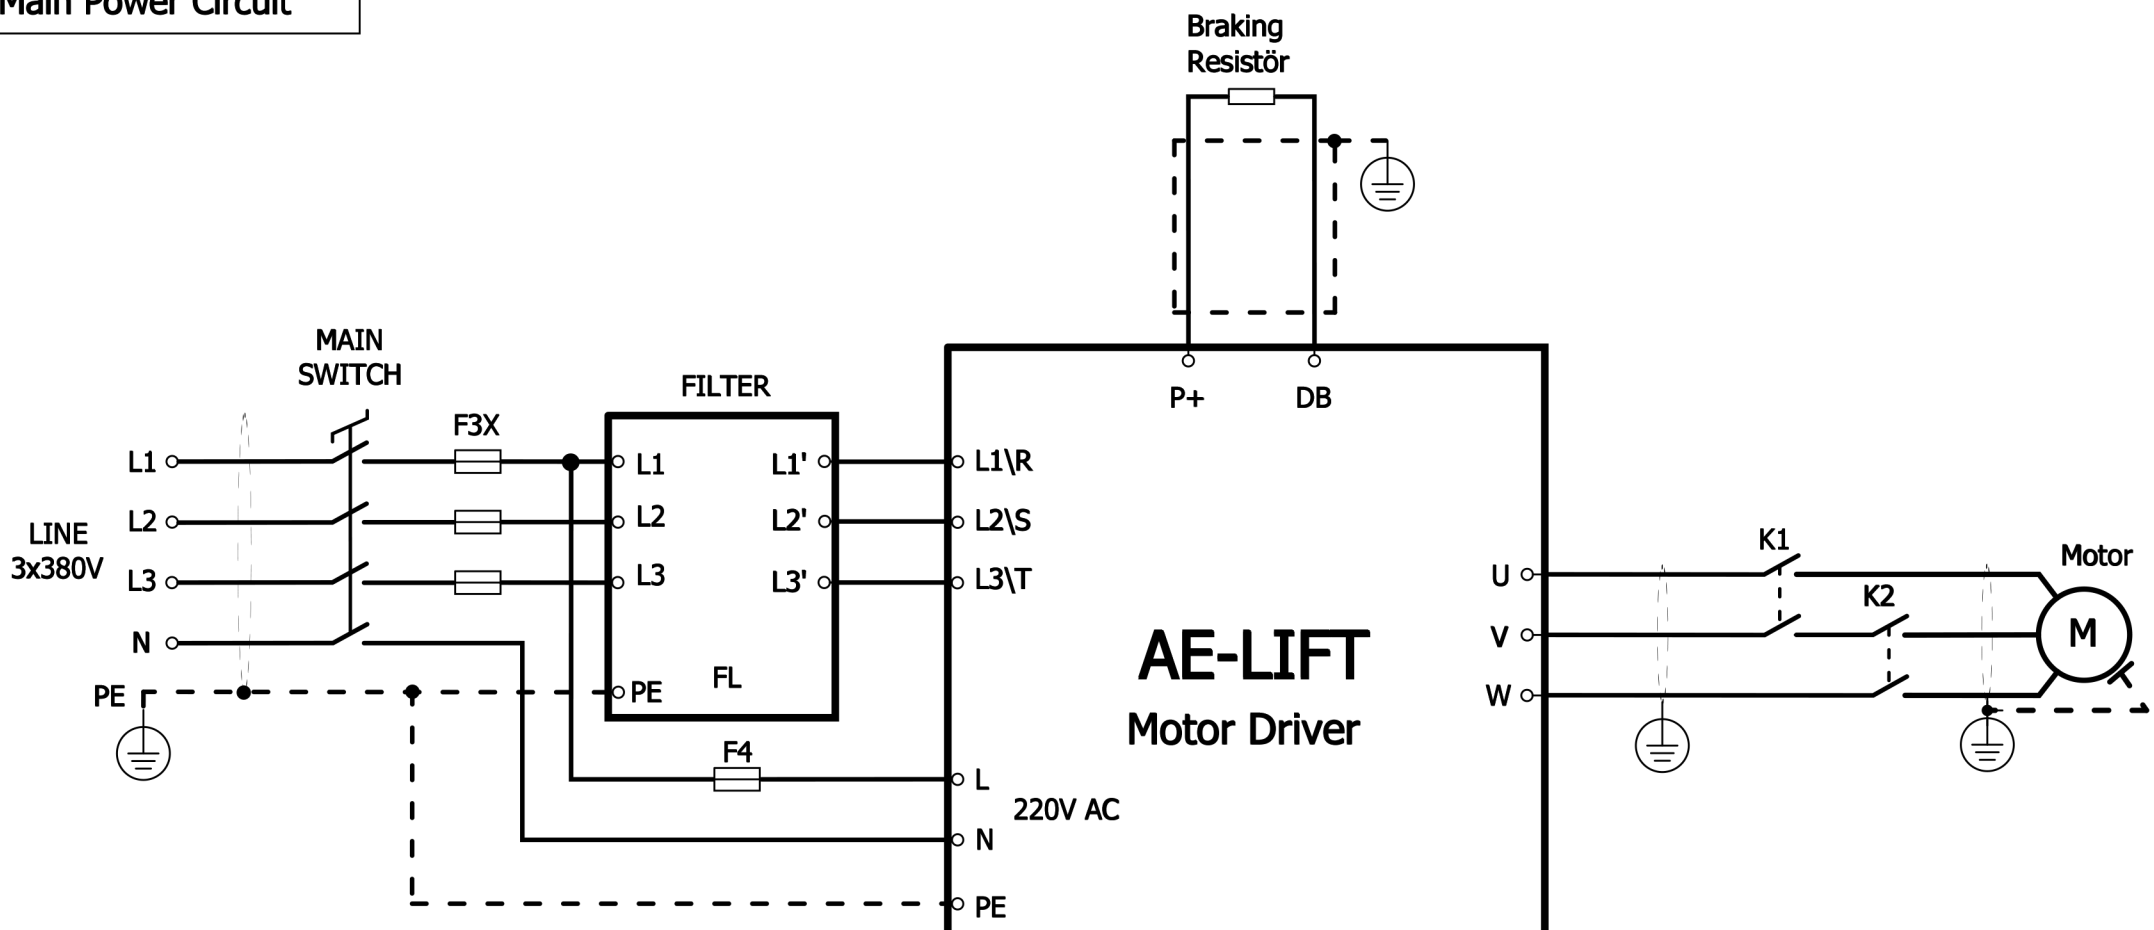


**Main Power Circuit**



**Control Circuit**

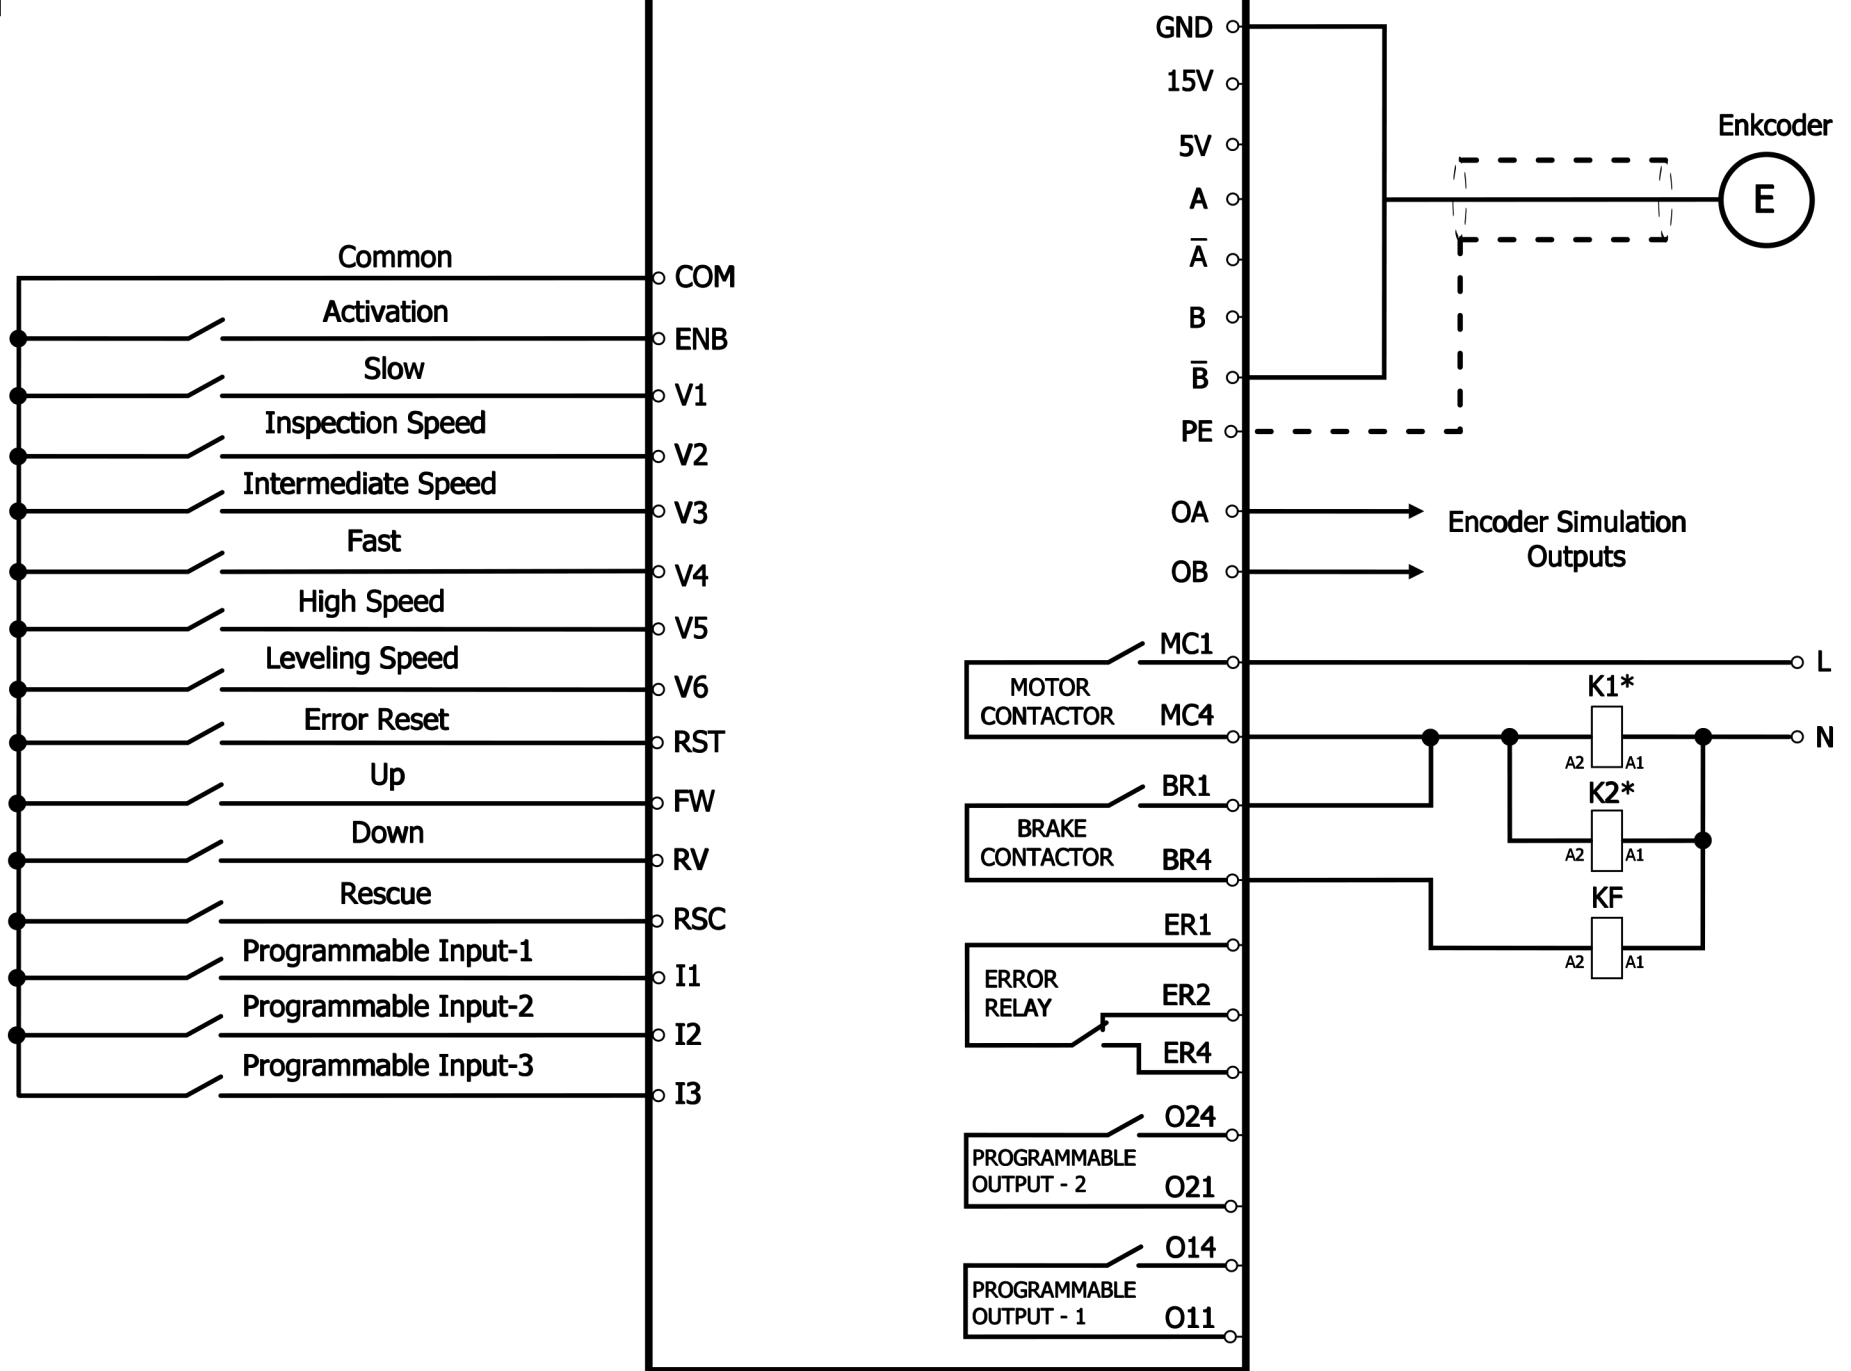

When motor contactors (K1\*-K2\*) are switched by AE-LIFT motor driver, any of programmable inputs I1, I2, I3 should be defined as contactor feature (MCF). And this connection should be implemented.

**AE-LIFT ELECTRICAL CONNECTIONS**

for model AEL07 (7,5kW), AEL11 (11kW), AEL15 (15 kW) and AEL22 (22kW)